

# TRANSCENDENCIAS COMERCIALES, S.L.


## PREINSTALLATION HC-1 Classic

ESCALA	FECHA	NOMBRE
DIBUJADO		AITOR LÓPEZ
MODIFICADO		

# HC1 CLASSIC

ESTA TERMINANTEMENTE PROHIBIDO REALIZAR CUALQUIER COPIA DE ESTE PLANO SIN PERMISO EXPRESO DE TRANSCENDENCIAS COMERCIALES,S.L.

The cold water inlet(1) and hot water inlet(2) copper pipes must be as low as possible so the pressure reducers outlet are close enough to connect  $\frac{1}{2}$ " flexibles.

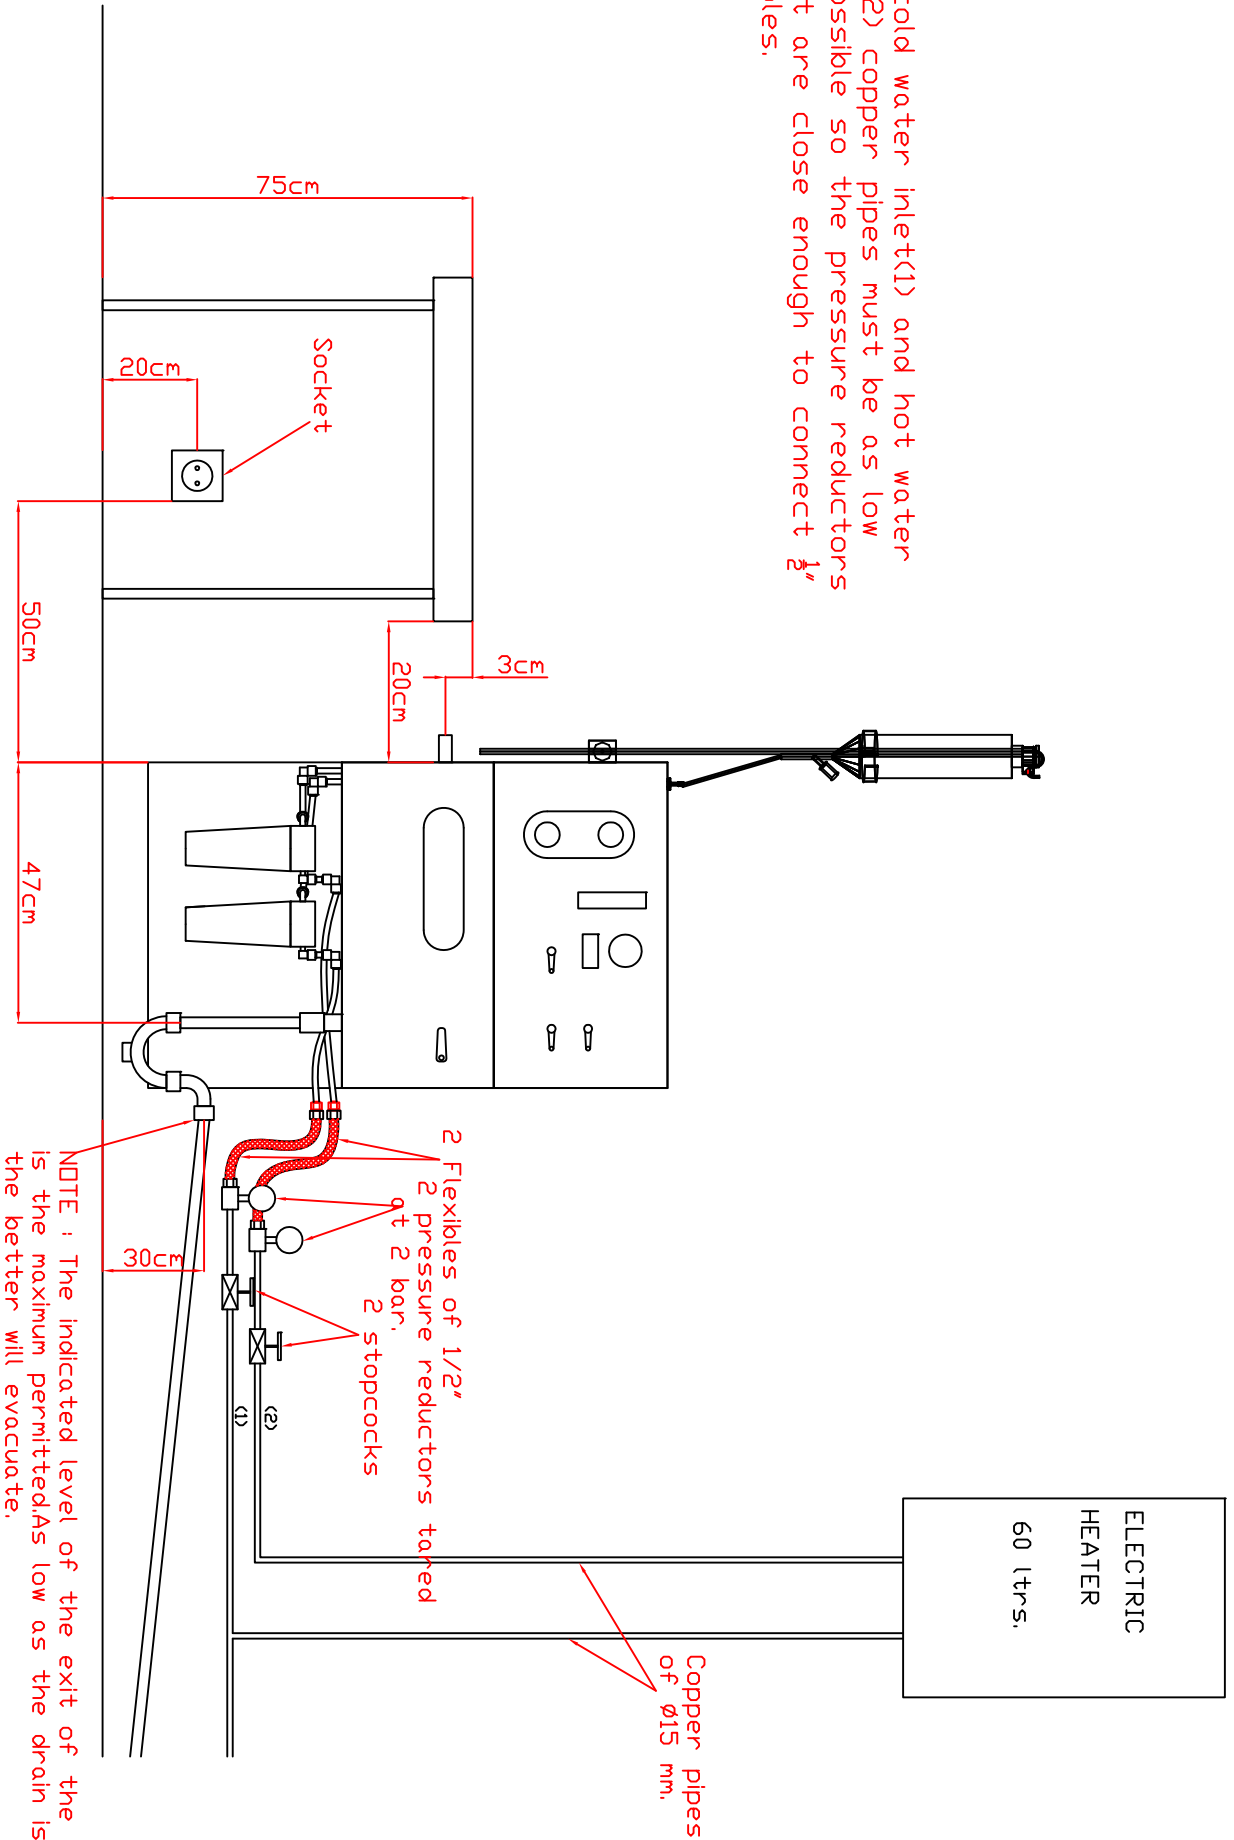

NOTE : The indicated level of the exit of the syphon is the maximum permitted, as low as the drain is located the better will evacuate.